


INSTALLATION INSTRUCTIONS FOR RUNNING MAN EXIT SIGN

Package Contents

Part	Description	Quantity
1	Emergency Exit Sign	1
2	Hardware Kit	1




Warnings and Cautions

IMPORTANT SAFEGUARDS

READ AND FOLLOW ALL SAFETY INSTRUCTIONS

1. Review the diagrams thoroughly before beginning.
2. All electrical connections must be in accordance with local codes, ordinances and the National Electric code.
3. Disconnect power at fuse or circuit breaker before installing or servicing.
4. Do not use outdoors.
5. Do not mount in hazardous locations, or near gas or electric heaters.
6. Do not let power cords touch hot surface.
7. Equipment should be mounted in locations and at heights where it will not be subjected to tampering by unauthorized personnel.
8. The use of accessory equipment not recommend by the manufacturer may cause an unsafe condition.
9. Do not use this equipment for other than intended use.
10. All servicing should be performed by qualified personnel only.
11. Allow battery to charge for 24 hours before first use.

SAVE THESE INSTRUCTIONS

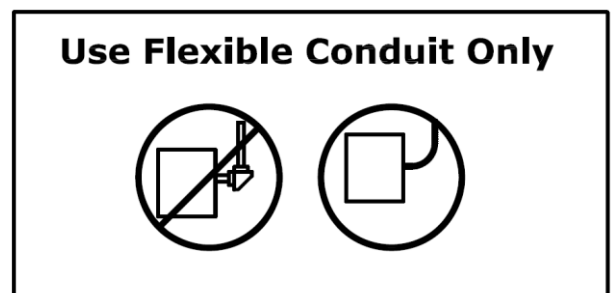

Mounting Instructions

NOTE: First turn off electricity.

Wall and Ceiling mounting

1. Open the EXIT housing and diffuser with a screwdriver.

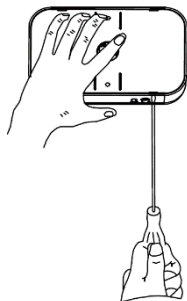


Fig 1

2. Knockout back of mounting plate and push wires through the hole.

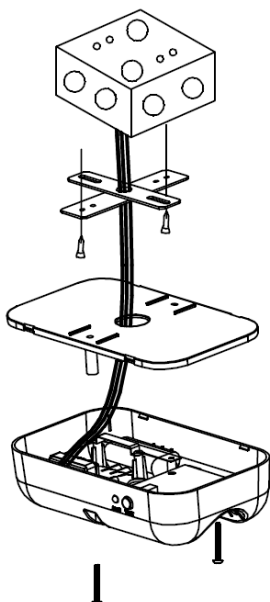


Fig 2

2. Make the proper supply lead connections.

If using 120VAC, connect the black and white leads to the building utility. If using 277VAC, connect the orange and white leads to the building utility. Cap off unused wire. If the unit is self-powered, be sure to snap battery connector together.

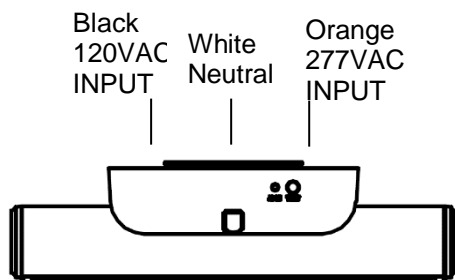


Fig 3

4. Insert correct PVC sheet into the panel (Fig 4). Place the sleeves onto the panel (Fig 5). Stick correct arrows on the panel (Fig 6), take off the sleeves.

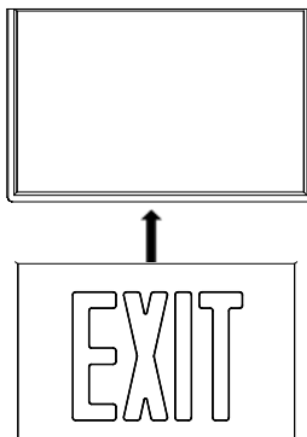


Fig 4

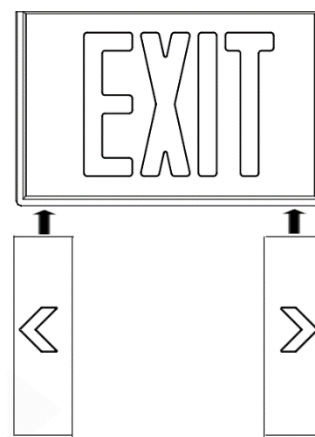


Fig 5

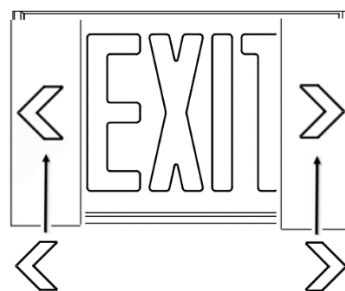


Fig 6

5. Twist off the cap on one side of the fixture. Slide the panel into the fixture and restore the cap.

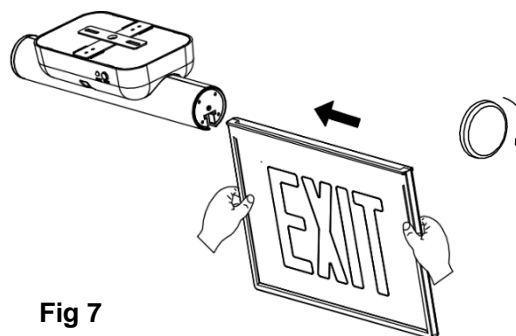


Fig 7

6. Restore power and press test button. Battery powered LED will come on, AC light will turn off.

7. Rotate the exit sign board by 90-degree for wall mounting.



Fig 8